



TeSuCon

Technical Support & Consultancy

REPORT TURBINE INSPECTION
SN 15401273, WINDPARK SLUFTER WEST 7



Report No. GE15002015007

20-11-2015

CONFIDENTIAL – Distribution to 3rd parties strictly prohibited

Contents

1 Purpose 3

2 Abbreviations..... 3

3 General information 4

4 Wind turbine main components 4

5 Documents..... 5

6 Logbook: Overview of recent maintenance 6

7 Logbook: Notable events 6

8 Tower and towerbase 7

9 Yaw system 8

10 Nacelle 9

11 Hydraulic system and brake 10


12 Gearbox and main shaft 10


13 Generator and coupling 12

14 Hub..... 13

15 Rotor blades 17

16 Conclusion..... 18

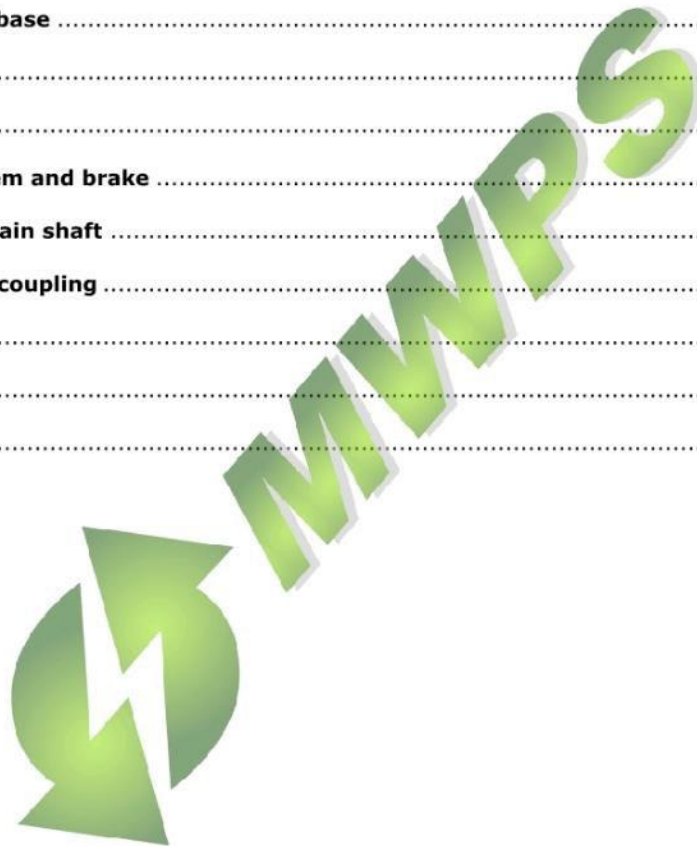

 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 2 of 18	

1 Purpose


On behalf of Vattenfall an inspection has been executed on the wind turbine. The purpose of the inspection is to determine the technical state of the wind turbine.

2 Abbreviations

ok	okay
nok	not okay
na	not applicable
nav	not available
nc	not checked
info	for information purpose

Items marked with "ok" and "info" show no visual irregularities. All issues which are not acceptable are marked with "**nok**". Items which are "**nok**" will be classified in three different classes.

Class	Clarification	Description in report
Priority Low	An irregularity, which is not a safety issue, and is relatively easy to solve.	<i>Low</i>
Priority High	An irregularity, which is not a safety issue, and is more serious and is more time and/or money consuming to solve.	<i>High</i>
Safety Issue	Issues which concern the safety of the people working in the turbine.	<i>Safe</i>


 TeSuCon Technical Support & Consultancy	Wind turbine inspection Windpark Slufter West 7	15401273
	Date: 20-11-2015	Page 3 of 18

3 General information

Wind turbine name:	Windpark Slufter West 7
Wind turbine type:	GE1.5S
Wind turbine S/N:	15401273
Location:	Rotterdam-Maasvlakte, NL
Hub height:	65
Nominal power [kW]:	1500
Year of installation:	2003
Date of inspection:	19-10-2015
Inspectors:	D. Lagerweij J. Langenbach


4 Wind turbine main components

Component	Type	Year	Serial number
Convertor	GE Power Convertor 151X1228KA02SA01	-	BY007SJV
Gearbox	Winergy PEAS 4390,2	-	4800952 - 0020 - 1
Revision gearbox	DPM Mølleservice	2014	126119
Gearbox oil	Mobilgear SHC XMP 320	2015	-
Generator	Winergy JFEA-500SR-04A	2003	5133514
Blade 1	GE Rotor Blades	-	2442
Blade 2	GE Rotor Blades	-	2441
Blade 3	GE Rotor Blades	-	2433

 TeSuCon <small>Technical Support & Consultancy</small>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 4 of 18	

5 Documents

	Component	Remark	
1	Operator manual	<p>Operating manual is available at the turbine.</p> <p>Machine directive 2006/45/EC, 1.7.4.2 states as part of the Contents of instructions:</p> <p><i>"(e) the drawings, diagrams, descriptions and explanations necessary for the use, maintenance and repair of the machinery and for checking its correct functioning;"</i></p>	ok
2	Wiring diagram	<p>Wiring diagrams are not available at the turbine.</p> <p>Machine directive 2006/45/EC, 1.7.4.2 states as part of the Contents of instructions:</p> <p><i>"(e) the drawings, diagrams, descriptions and explanations necessary for the use, maintenance and repair of the machinery and for checking its correct functioning;"</i></p>	ok
3	Hydraulic diagram	<p>Hydraulic diagrams are not available at the turbine.</p> <p>Machine directive 2006/45/EC, 1.7.4.2 states as part of the Contents of instructions:</p> <p><i>"(e) the drawings, diagrams, descriptions and explanations necessary for the use, maintenance and repair of the machinery and for checking its correct functioning;"</i></p>	nok
4	Maintenance manual	<p>Maintenance manual is not available at the turbine.</p> <p>Machine directive 2006/45/EC, 1.7.4.2 states as part of the Contents of instructions:</p> <p><i>"(e) the drawings, diagrams, descriptions and explanations necessary for the use, maintenance and repair of the machinery and for checking its correct functioning;"</i></p>	nok
5	Logbook	<p>Logbook is available at the turbine.</p>	ok


 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 5 of 18	

6 Logbook: Overview of recent maintenance





Year	Type of maintenance	Date of execution	Maintenance schedule
	Commissioning	09-2003	2003
...
9	1 year service	21-11-2012	2012
9½	½ year service	15-03-2013	
10	1 year service	11-09-2013	2013
10½	½ year service	23-04-2014	
11	1 year service	20-11-2014	2014
11½	½ year service	08-07-2015	
12	1 year service	<i>no service record</i>	2015


7 Logbook: Notable events

Date	Event
07-05-2010	Convertor exchange
11-09-2013	New torque-arm dampers
22-01-2014	Slip ring hub replaced
03-09-2014	HSS bearing and DE bearing generator replaced
20-11-2014	Exchanged all battery packs in the hub
08-06-2015	Gearbox and main bearing exchange

 TeSuCon Technical Support & Consultancy	Wind turbine inspection Windpark Slufter West 7	15401273
	Date: 20-11-2015	Page 6 of 18


8 Tower and towerbase

Item	Remark		
1	Tower outside	Light at the outside is broken and has damaged the paint of the tower. 	<div style="text-align: right;">  Low </div>
2	Controller overview		<div style="text-align: right;"> Info </div>
3	Tower inside		<div style="text-align: right;"> Info </div>
4	Miscellaneous		<div style="text-align: right;"> ok </div>

 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 7 of 18	


9 Yaw system

	Item	Remark	
1	Yaw section		ok
2	Yaw ring teeth	Yaw ring shows no irregularities. 	ok
3	Yaw pinions	Yaw pinions show no irregularities. 	ok
4	Yaw gears	Gears are corroded. 	<div style="color: red; font-weight: bold;">nok</div> High



 TeSuCon Technical Support & Consultancy	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 8 of 18	

10 Nacelle

	Item	Remark	
1	Nacelle overview		Info
2	Frame	Turbine is equipped with a cast-iron frame.	Info
3	Nacelle housing	<p>Parts of the insulation are damaged. The air cooling hatch at the bottom of the nacelle is not mounted correctly.</p> 	<div style="text-align: center;">  Low </div>
4	Weather station		Info
5	Controller overview		Info


 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 9 of 18	

11 Hydraulic system and brake


	Item	Remark	
1	Overview		Info
2	Leakage	Leakage at the hydraulic hose of the brake. 	<div style="background-color: red; color: white; padding: 2px; display: inline-block;">OK</div> High
3	Miscellaneous		ok

12 Gearbox and main shaft

	Item	Remark	
1	Main shaft bearings	Grease of the main bearing is not magnetic.  	ok

 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 10 of 18	


2	Radiators		<i>Info</i>
3	CCJ-unit	No CCJ-filter present in the turbine.	<i>Info</i>
4	Gear oil system	Minor oil leakage present at the gear oil system.  	Low <i>Low</i>
5	Hoses and pipes		ok
6	Paint / Corrosion		ok
7	General leakage		ok
8	Slip ring for hub		<i>Info</i>

 TeSuCon Technical Support & Consultancy	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 11 of 18	




9	Miscellaneous	The seal of the inspection hatch of the gearbox is damaged.		nok Low
---	---------------	---	---	-------------------


13 Generator and coupling





Item	Remark			
1	Coupling	The coupling shows no irregularities.		Info
2	Paint / Corrosion			ok
3	Slip ring	Raceway of the earth connection is not completely smooth (2 th picture).		nok High


 TeSuCon Technical Support & Consultancy	Wind turbine inspection Windpark Slufter West 7	15401273
	Date: 20-11-2015	Page 12 of 18

14 Hub


	Item	Remark	
1	Blade bearing	<p>Several small cracks are visible at the caps of the blade bearing bolts.</p> 	<p>Low</p>
2	Overview inside	<p>In general, the hub is clean and there is no excessive corrosion present.</p> 	<p><i>Info</i></p>
3	Hub cabinet overview		<p><i>Info</i></p>



 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 13 of 18	


4	Boxes blade 1	Control box and battery box show no irregularities. 	ok
5	Boxes blade 2	Control box and battery box show no irregularities. 	ok
6	Boxes blade 3	Control box and battery box show no irregularities. 	ok
7	Mounting of the electrical boxes	The mounting of the boxes shows no irregularities. 	ok

 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 14 of 18	

8	Pinions of pitch gears	<p>Wear on one tooth of the pinions of the pitch gears.</p> 	<p>not High</p>
9	Pitch teeth at zero of blade 1	<p>The tooth at zero shows wear.</p> 	<p>not High</p>
10	Pitch teeth at zero of blade 2	<p>The tooth at zero shows wear.</p> 	<p>not High</p>


 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 15 of 18	

11	Pitch teeth at zero of blade 3	<p>The tooth at zero shows wear.</p> 	<p>ok High</p>
12	Grease system pitch teeth	<p>There is no automatic grease system present in the hub.</p> 	<p>Info</p>
13	Pitch gears	<p>Some corrosion visible at the base of the pitch gears.</p> 	<p>ok Low</p>
14	Miscellaneous		<p>ok</p>

 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 16 of 18	

15 Rotor blades

1	Blades	<p>Repaired parts are visible on the leading edges of the blades.</p> 	Info
---	--------	---	------

 <p>TeSuCon Technical Support & Consultancy</p>	Wind turbine inspection Windpark Slufter West 7		15401273
	Date: 20-11-2015	Page 17 of 18	

16 Conclusion

The logbook shows that the turbine has been maintained on a regular basis, according to the maintenance schedule of GE.

The gearbox and the main bearing have been replaced in 2015. The original generator is present in the turbine and the DE-bearing has been replaced in 2014.

The blades have been maintained recently.

The wear of the zero-tooth of the pitch ring is serious, but it is possible to solve this problem by assigning another tooth to be the zero-tooth. Dismounting and remounting of the blades is necessary to achieve this. The same thing can be done with the pinions, although replacing the pitch gears (with the pinions) is also an option.


The overall condition of the turbine is quite acceptable for a twelve year old turbine. There are however several issues (marked as **red** in this report) present and it is recommended to solve these, in order to improve the condition of the turbine.



D. Lagerweij

20-11-2015

TeSuCon B.V.
Mercuriusweg 8
3771NC Barneveld
+31610032858
dl@tesucon.nl
www.tesucon.nl

 TeSuCon Technical Support & Consultancy	Wind turbine inspection Windpark Slufter West 7	15401273
	Date: 20-11-2015	Page 18 of 18



TeSuCon

Technical Support & Consultancy

REPORT GEARBOX INSPECTION
SN 15401273, WINDPARK SLUFTER WEST 7



Report no. GE15002015017

24-11-2015

CONFIDENTIAL – Distribution to 3rd parties strictly prohibited

Contents

1. Purpose 3

2. General Information 3

3. Reporting setup 4

4. Inspection results 5

5. Summary 16

6. Conclusion 16



 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 2 of 16	

1. Purpose


On behalf of Vattenfall an inspection has been executed on the wind turbine gearbox. The purpose of the inspection is to determine the technical state of the gearbox. The visual inspection of the gearbox has been executed with a GE Everest XLG3 Videoscoop.

2. General Information

Turbine Information	
Wind turbine name:	Windpark Slufter West 7
Wind turbine type:	GE1.5S
Wind turbine serial no:	15401273
Location:	Rotterdam-Maasvlakte, NL
Hub height:	65
Nominal power [kW]:	1500
Year of installation:	2003
Date of inspection:	19-10-2015
Inspectors:	D. Lagerweij J. Langenbach


Gearbox Information	
Gearbox type:	Winergy PEAS 4390,2 <i>i = 90,302</i>
Gearbox serial number:	4800952 - 0020 - 1
Production year gearbox:	-
Revision:	DMP Mølleservice 10-11-2014
Revision number:	126119
Oil type:	Mobilgear SHC XMP 320
Date of last oil change:	06-2015

- **Gearbox has been exchanged in 2015**

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015		Page 3 of 16

3. Reporting setup

The next drawing shows a cross-section of a planetary gearbox with two linear stages with corresponding bearing positions. The drawing should be used as a reference for the bearing position only.

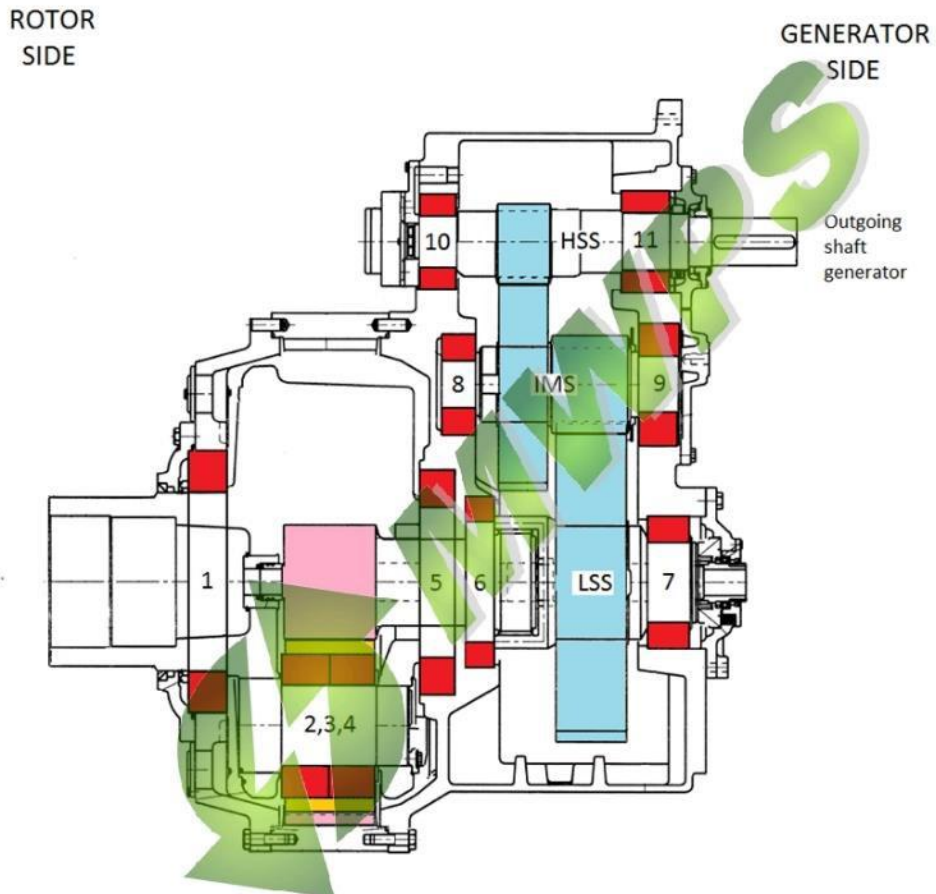

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015		Page 4 of 16

4. Inspection results



Picture 1


Picture 1 shows bearing position no. 1, the bearing of the planet carrier at rotor side. No irregularities.



Picture 2

Picture 2 shows the bearing of the first planet wheel. No irregularities.

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 5 of 16	

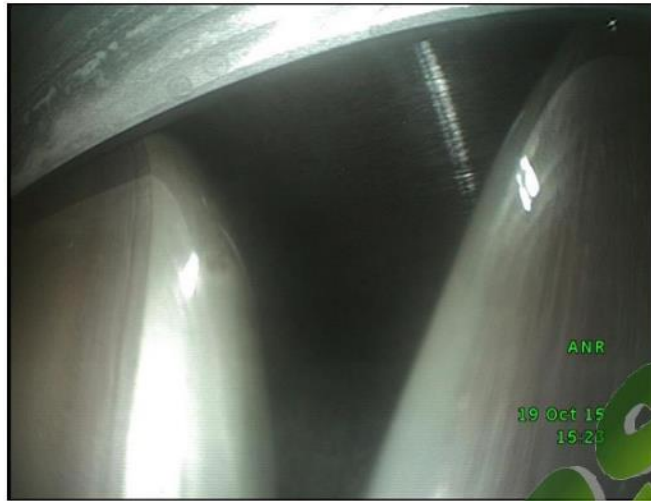

Picture 3


Picture 3 shows the bearing of the second planet wheel. No irregularities.



Picture 4


Picture 4 shows the bearing of the third planet wheel. No irregularities.

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 6 of 16	

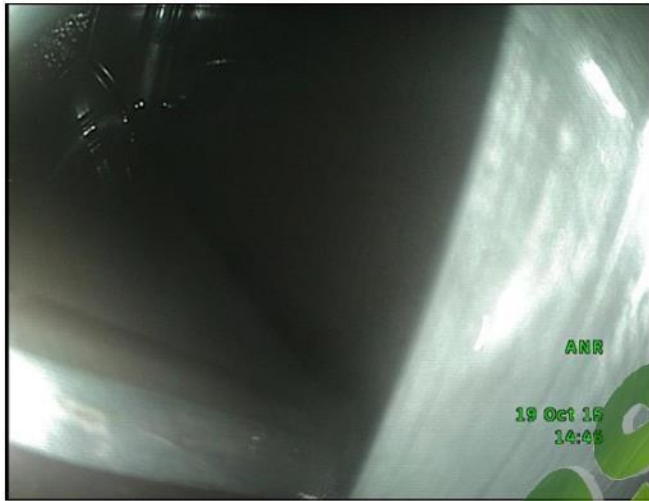

Picture 5

Picture 5 shows bearing position no. 5, the bearing of the planet carrier at generator side. The bearing shows no irregularities.

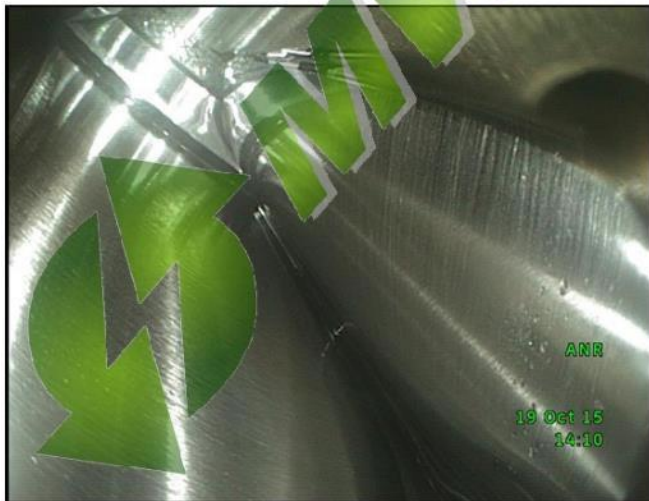

Picture 6


Picture 6 shows bearing position no. 6, the bearing of the low speed shaft at rotor side. The bearing shows no irregularities.

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 7 of 16	



Picture 7


Picture 7 shows bearing position no. 7, the bearing of the low speed shaft at generator side. The bearing shows no irregularities.

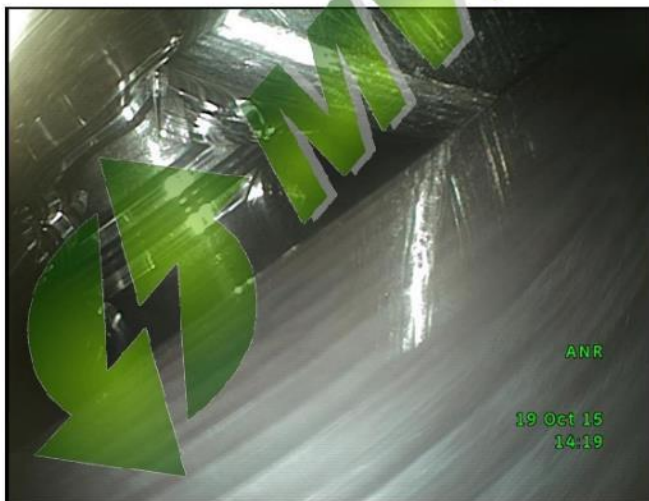

Picture 8

Picture 8 shows bearing position no. 8, the bearing of the intermediate shaft at rotor side. The bearing shows no irregularities.

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 8 of 16	

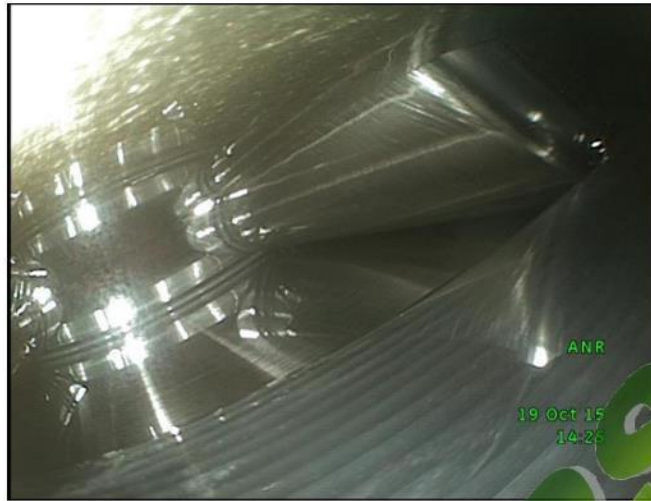

Picture 9


Picture 9 shows bearing position no. 9, the bearing of the intermediate shaft at generator side. The bearing shows no irregularities.



Picture 10


Picture 10 shows bearing position no. 10, the bearing of the high speed shaft at rotor side. The bearing shows no irregularities.

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 9 of 16	

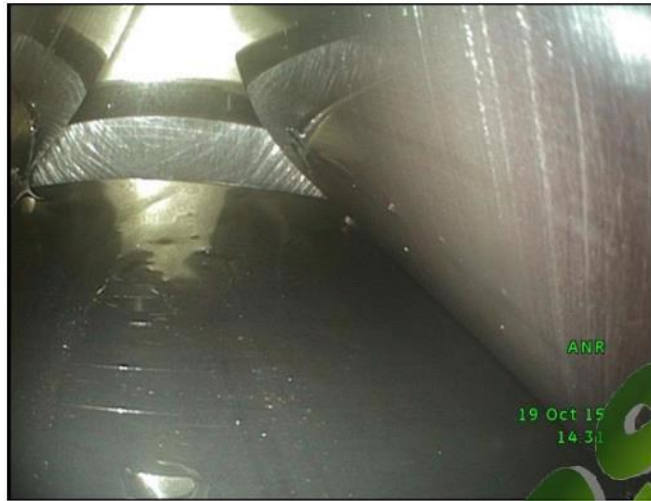

Picture 11


Picture 11 shows bearing position no. 11, the radial bearing of the high speed shaft at generator side. The bearing shows no irregularities.

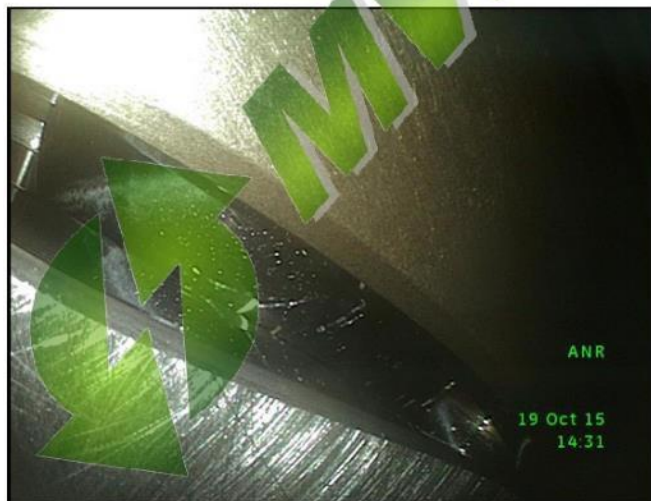

Picture 12


Picture 12 shows bearing position no. 11, the axial bearing of the high speed shaft at generator side. The bearing shows no irregularities.

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 10 of 16	

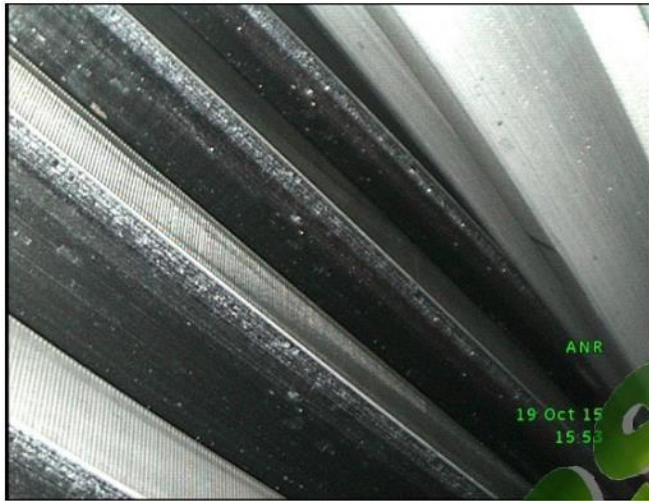

Picture 13


Picture 13 shows the active flank of the ring gear. No irregularities.

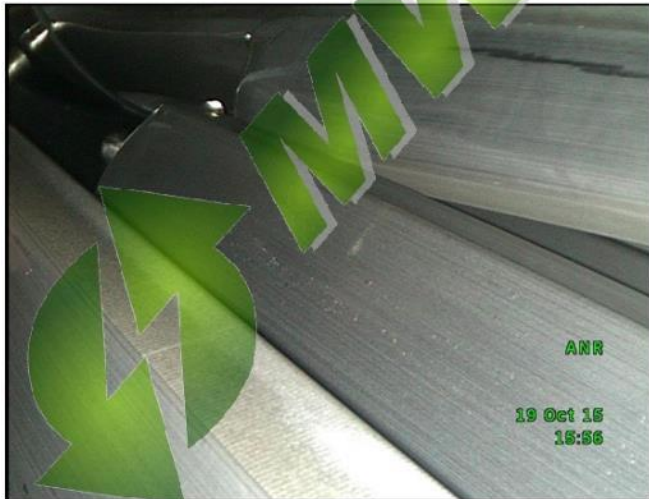

Picture 14


Picture 14 shows one of the planet wheels. None of the planet wheels show irregularities.

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 11 of 16	

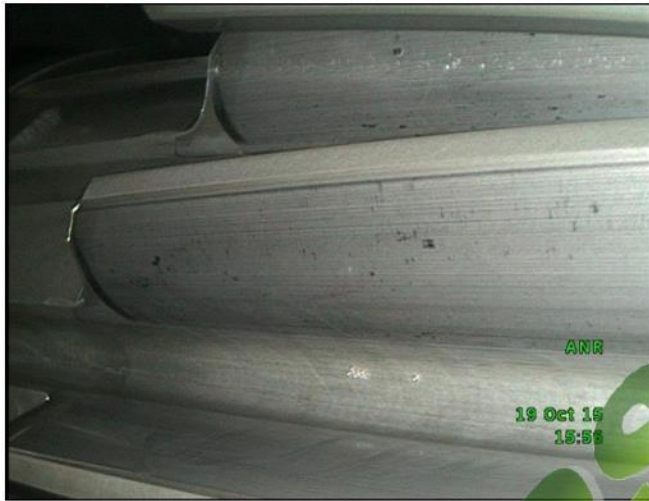

Picture 15


Picture 15 shows the active flanks of the sun pinion. No irregularities.

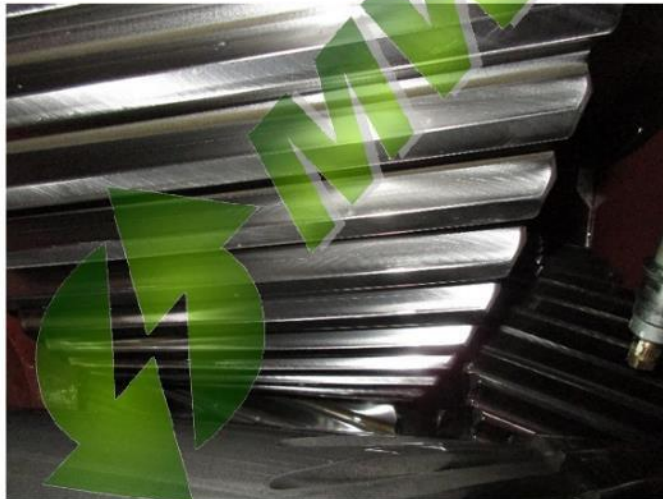

Picture 16


Picture 16 shows the active flanks of the wheel of the low speed shaft in the linear stage. No irregularities.

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 12 of 16	

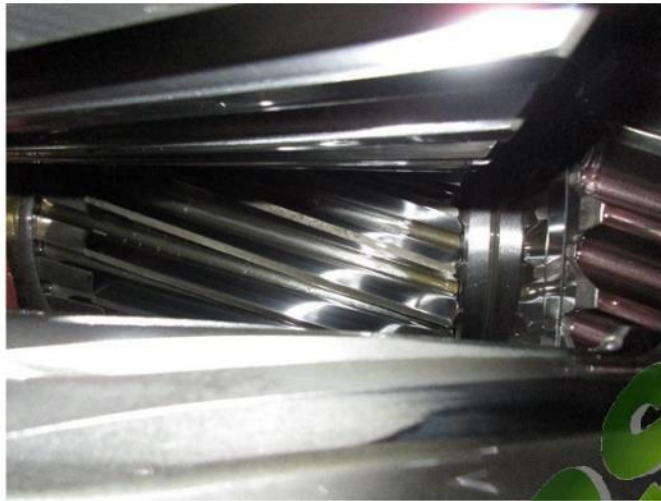

Picture 17


Picture 17 shows the active flanks of the pinion of the intermediate shaft in the linear stage. No irregularities.

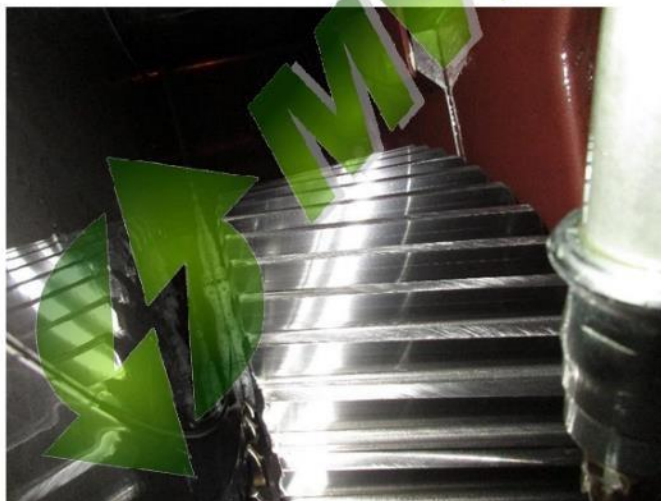

Picture 18


Picture 18 shows the active flanks of the wheel of the intermediate shaft in the linear stage. No irregularities.

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 13 of 16	

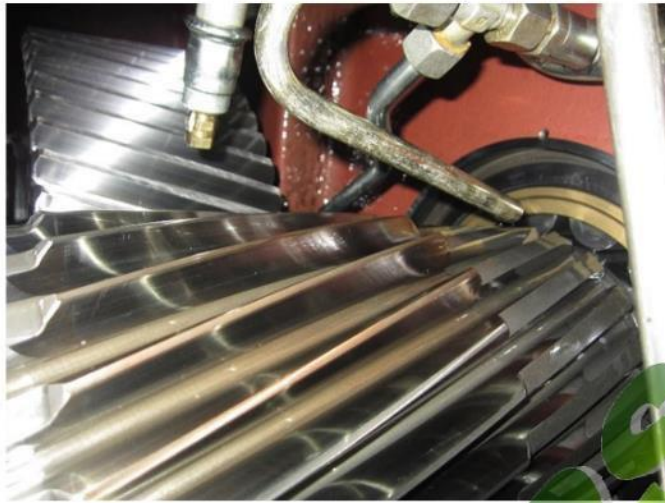

Picture 19

Picture 19 shows the active flanks of the pinion of the high speed shaft in the linear stage. No irregularities.

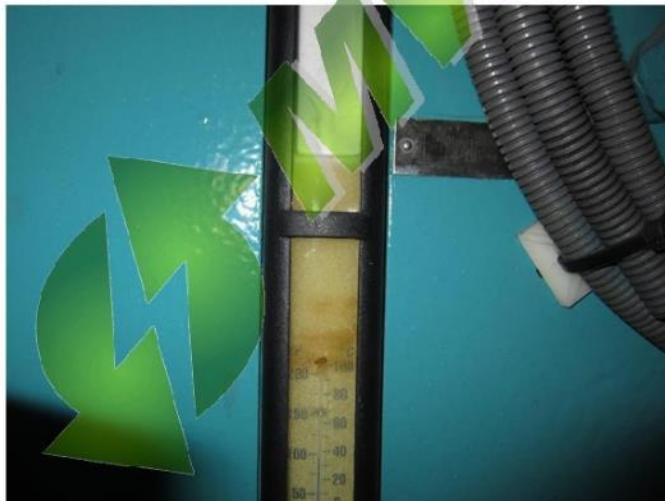

Picture 20


Picture 20 shows the oil level of the gearbox. The oil level is correct.


 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 14 of 16	



Picture 21

The inside and bottom of the gearbox have been searched with a magnet. The magnet shows no steel particles.

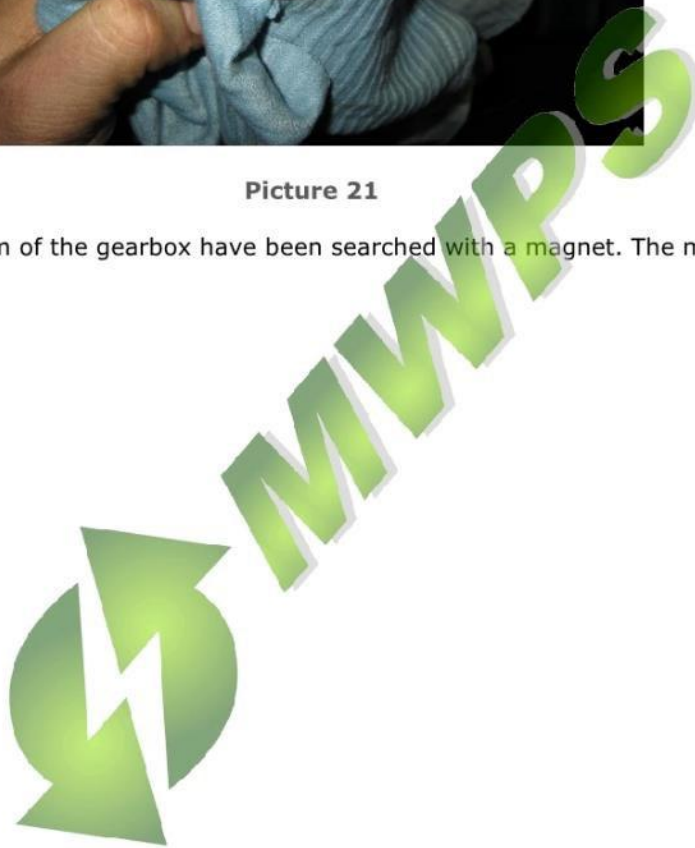

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 15 of 16	

5. Summary

The visual inspection of the gearbox shows no signs of severe pitting, major damages or extreme wear.

The oil level is correct and no steel particles were found in the gearbox.

6. Conclusion

The condition of the gearbox is acceptable.



Dennis Lagerweij

Barneveld, 24-11-2015

TeSuCon B.V.
Mercuriusweg 8
3771NC Barneveld
The Netherlands
Tel +31610032858
Email dl@tesucon.nl
Web www.tesucon.nl

 TeSuCon Technical Support & Consultancy	Gearbox inspection Windpark Slufter West 7		15401273
	Date: 24-11-2015	Page 16 of 16	